



# **A Case Study on Sustainable Production and Use of Compressed Air in European Industrial Sites of Medium-sized**

**Bryan Thomas <sup>a\*</sup>**

<sup>a</sup> Anglia Ruskin University, UK.

**Author's contribution**

*The sole author designed, analysed, interpreted and prepared the manuscript.*

**Article Information**

DOI: 10.9734/AJEE/2023/v20i3443

**Open Peer Review History:**

This journal follows the Advanced Open Peer Review policy. Identity of the Reviewers, Editor(s) and additional Reviewers, peer review comments, different versions of the manuscript, comments of the editors, etc are available here: <https://www.sdiarticle5.com/review-history/98265>

**Original Research Article**

**Received: 07/02/2023**

**Accepted: 10/04/2023**

**Published: 18/04/2023**

## **ABSTRACT**

Due to the urgency in climate change, the industry is mobilized to reduce its greenhouse gases. Compressed air represents nearly 10% of electricity used in industry. The research was carried out in an industrial food site in Europe. This research includes a case study and gives a specific approach and methodology to optimize environmental and economic impact of compressed air production and uses in an industrial site. The installation of this case study contains different type of compressed air, dryers, and filters. Each equipment has been subject to specific monitoring and analysis. Several actions have been identified for reducing carbon emissions by 69 tons such as: reduction of the compressed air pressure of the system, isolation of packaging lines when they are not running, implementation of pumps for vacuum generation on packaging lines, installation of smart management device and a heat recovery system. Financial savings are around 44 000 euros, and the average payback is below 3 years.

\*Corresponding author: E-mail: [thomas.75.bryan@gmail.com](mailto:thomas.75.bryan@gmail.com);

*Keywords: Carbon emissions; greenhouse gases; Global energy consumption; climate change.*

## 1. INTRODUCTION

Global energy consumption has doubled over the past four decades, and this trend will continue with an average annual increase of 1.5% in the period from 2018 to 2050 [1].

Compressed air is an energy widely used in the industrial sector and companies continuously seek process to decarbonize it [2]. In fact, industrial compressed air is often used as a source of energy for several types of uses such as process air, pneumatic control and control of automated robots, operation of suction cups with venturi or transport of powder and granular products [3]. Compressed air is also used for energy storage technology and received increasing attention in addressing the issue of intermittent renewable energy [4].

Compressed air represents nearly 10% of electricity used in industry [5,6]. In order to reduce carbon footprint of the industry sector, each industrial site must reduce its compressed air consumption [7,8]. According to Çağman et al. [9], a compressed air system can use only 10–30% of the consumed energy to produce compressed air and therefore compressed air systems are classified as the most inefficient systems energized by electricity regarding high energy consumption.

This paper is a case study on an industrial site. This site uses compressed air for a variety of both process and instrument air applications. It is an essential service (vital to production).

The compressed air system is currently running well but the main duty compressor is now the highest individual electricity user on site, as identified by pareto analysis of the numerous power meters that have been installed around the site [10].

The air system has been upgraded considerably in the past few years and in terms of compressor selection, treatment and distribution system is considered to show good practice.

The site currently has three main compressors with a very small fourth used solely at weekends to supply permanently operating equipment such as cooling towers.

The aim of this study is to identify carbon and cost savings that may be achieved.

## 2. MATERIALS AND METHODS

### 2.1 The Compressed Air Installation

Compressed air is generated at a central location on the industrial site to supply air at around 8 barg for process and instrumentation purposes to all areas of the site. Fig. 1 represents the whole system in a schematic diagram.

The air is generated by three air cooled, two stages, and oil free rotary screw compressors. One of the compressors is fitted with a variable speed drive (VSD). The two standby units are 55 kW with a 160 kW duty VSD which runs all week. Once production finishes on a Saturday afternoon the system is isolated, and a small 2 kW compressor is used solely to supply permanently operating equipment such as cooling towers. The compressors are controlled from their individual pressure switches with no central controller.


Following generation, the air is treated by filtration and desiccant dryer (to fix water molecules) to a dewpoint of  $-40\text{ }^{\circ}\text{C}$  by a zero-purge loss heat regenerated desiccant dryer with associated pre and after filtration. A second dryer is retained as standby but is normally isolated.

Compressed air is stored in two 2000 liters tanks (1 tank before dryers and 1 tank after dryers) to prevent high and variable pressure differential.

The site has a monitoring infrastructure with regards to compressed air. Power meters are installed on the main supply panel to each compressor and the main dryer, which feed back to the site Energy Monitoring System (EMS). A flowmeter, a dewpoint meter and a pressure transducer in the compressor house also feed back to the site Building Monitoring System (BMS).

The compressor house is located on the south side of the plant on an outside wall, with good ventilation on two sides.

Although the compressor room is quite compact for the amount of equipment, it is well laid out with adequate ventilation and room for maintenance. Hot exhaust air is ducted outside although there is the possibility to open it to the compressor house if the internal temperature is too cold. The hot exhaust air is also ducted to the

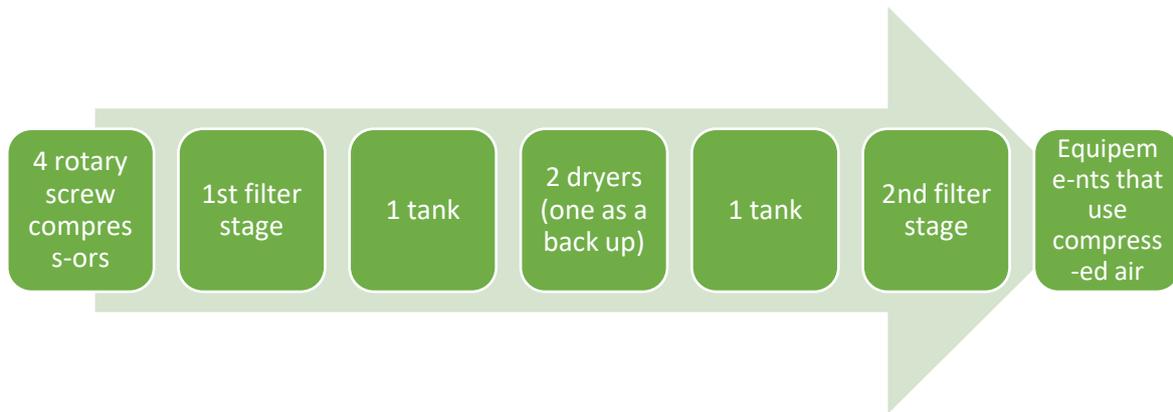

**Fig. 1. Schematic diagram of the compressed air system**

**Table 1. Main settings of the compressors**

Compressor number	Type	Rated output (m <sup>3</sup> /h)	Rated power (kW)	Hours run
1	Air cooled, oil free screw, VSD	1476	160	21855
2	Air cooled, oil free screw, fixed speed	468	55	14682
3	Air cooled, oil free screw, fixed speed	516	55	10901
4	Air cooled, oil free piston, fixed speed	9	2	1872
-	Total	2469	272	-

dryer to supply the electrical regeneration air heater with hotter air than it would normally get from ambient conditions.

## 2.2 Compressors' Performance Analysis

The Table 1 contains the main settings of the compressors.

The 160 kW VSD compressor (main compressor) has run to the following pattern based on data in EMS and BMS:

- Time at 0 -20% speed → 0%
- Time at 20 – 40% speed → 35%
- Time at 40 – 60% speed → 36%
- Time at 60 – 80% speed → 25%
- Time at 80 – 100% speed → 4%

This pattern is good and indicates that the compressor has normally been operated in its efficient control range (below 80%).

A VSD equipment present many advantages [11]. In fact, using VSD systems provide the opportunity to save about 15 to 40% of the energy and extend equipment lifetime by allowing soft start-up and shutdown [12,13].

Readings taken on the main compressor (160 kW) during the survey are described in the Table 2.

**Table 2. Readings taken during the survey**

Parameter	Reading
Speed	3200 rpm
Discharge pressure	7.9 barg
Inlet filter differential pressure	0.003 barg
Oil pressure	3.6 barg
Oil temperature	44C
Interstage pressure	2.37 barg
Inlet temperature	21 °C
Stage 1 exit temperature	174 °C
Stage 2 inlet temperature	31 °C
Stage 2 exit temperature	156 °C
Compressor exit temperature	29 °C

The above readings are normal, the interstage pressure is higher than expected for a fixed speed machine but fairly typical for a variable speed machine.

The compressor 2 and compressor 3 do not normally run. The compressor 2 ran for a short period after fitting a logger and showed full load power consumption of 64 kW and no load of 17.3 kW at 7.3 barg, which is in line with design

figures. Both machines have low running hours and are well maintained on service contracts so we cannot expect major issues with these machines.

The small compressor is retained for weekend use and supplies few systems. This is good a practice.

### 2.3 System Demand Measurement

The system demand is measured using an Endress & Hauser Mass flowmeter. The demand pattern across a typical full production week is represented in Fig. 2.

The Fig. 2 shows an average demand of around 1000 Nm<sup>3</sup>/h during week time production, dropping to half this on Saturday when there is limited production. The peak demand is around 1800 Nm<sup>3</sup>/h, which can bring in the compressor 2, although this varies each week. The system is isolated once production finishes around 18:00 on Saturday and is off for approximately 36 hours.

During shutdown periods (in August for example), the demand is much lower and can be

met by one of the 55 kW machines (i.e., compressor 2 or 3) as seen in Fig. 3. Over a year the average demand when the main compressors are running is around 750 Nm<sup>3</sup>/h.

The flowmeter appears to be reading higher than it should. The VSD compressor has a rated output of around 1500 m<sup>3</sup>/h but the flowmeter shows readings of up to 1700 Nm<sup>3</sup>/h (with just the VSD compressor online). It is thought that this is due to the location of the flowmeter, which is fairly close to a bend. The manufacturer recommends 20 diameters of straight pipe before and after the flowmeter. In this case, it is only around 5 to 6 diameters. The location of the flowmeter is shown in Fig. 4.

### 2.4 Presentation and Analysis of Air Treatment System

Installed equipment for the drying step:

- 1 heat regenerated desiccant dryer; Rated flow = 2250 m<sup>3</sup>/h; Main dryer
- 1 Air regenerated desiccant dryer; Rated flow = 1650 m<sup>3</sup>/h; Back-up dryer

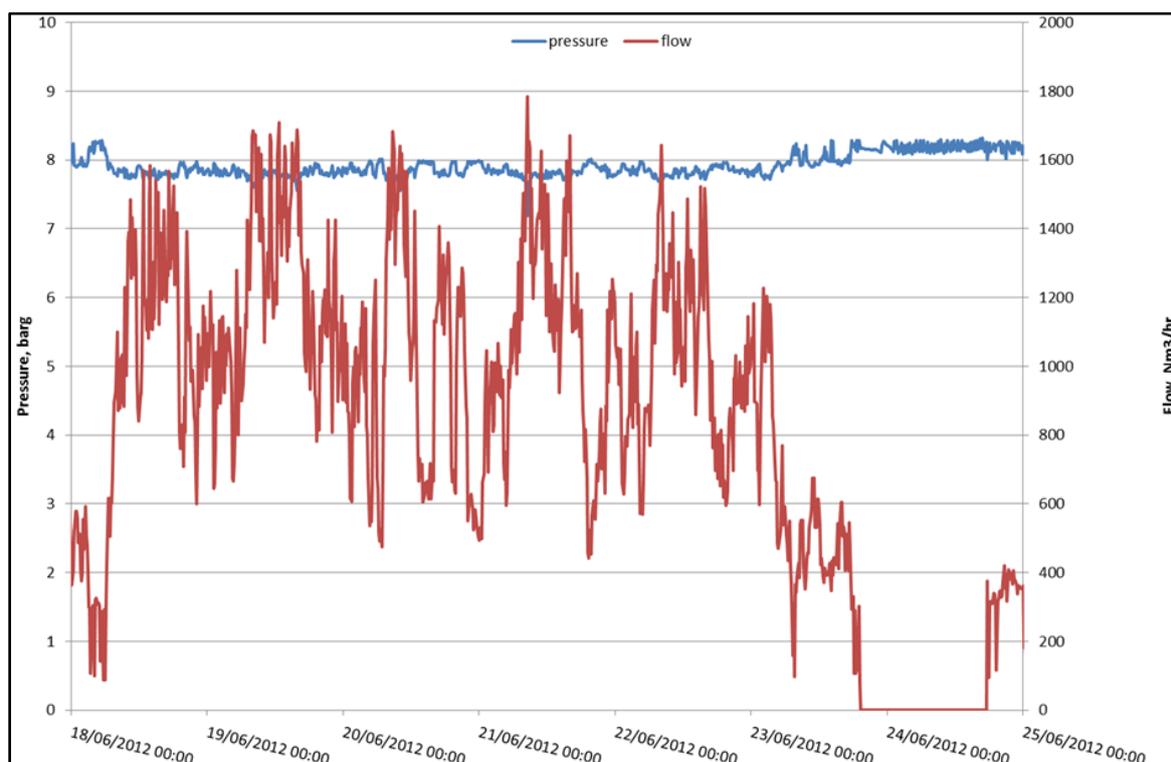


Fig. 2. System demand and pressure during normal week

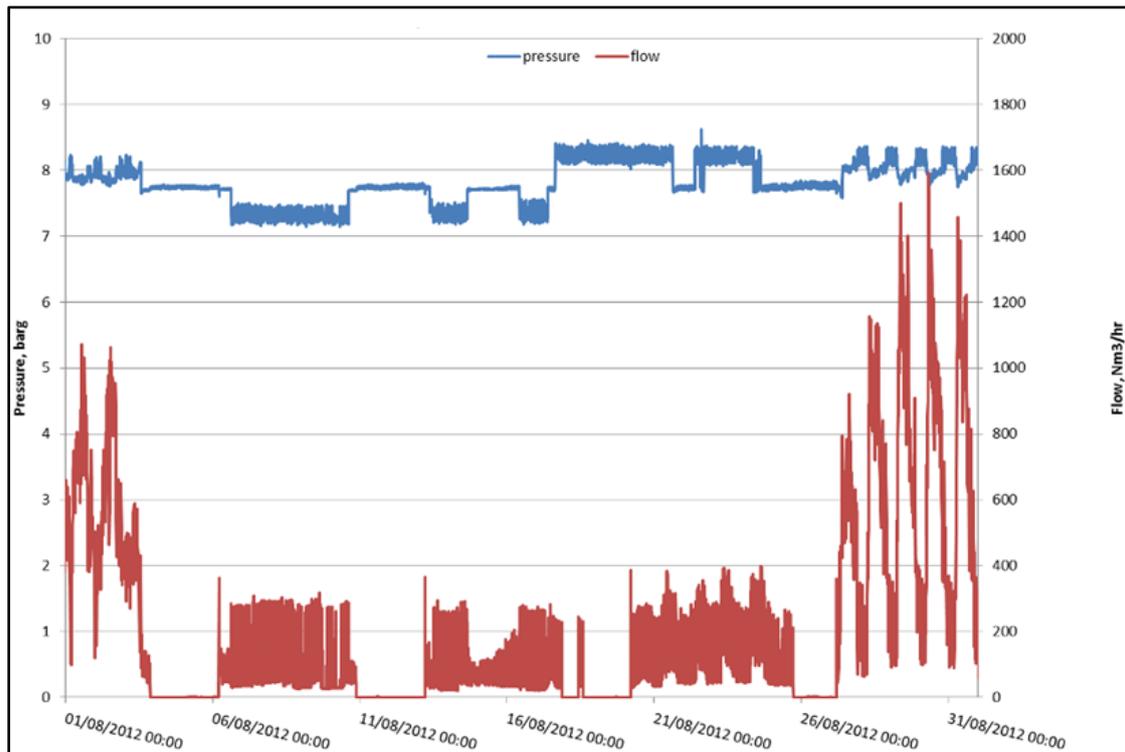


Fig. 3. System demand and pressure during site shutdown



Fig. 4. Compressed air flowmeter location

Installed equipment for the filtering step:

- 1 Prefilter: Protect the network from particles. Efficiency = 99.999% until 0.01 µm.
- 1 After filter: It's a carbon active filter. It stops oil vapours, tastes, and smells up to 0.003 mg/ m<sup>3</sup>
- 1 Sterile after filter: Ensure a very efficient filtration, because it stops particles, organisms, liquid aerosols and, dust resulting from the abrasion of the dryer's alumina balls. Efficiency = 99.99998% until 0.01 µm

In order to check the drop pressure across the treatment system a pressure transducer is in place downstream of the final filter. Due to the pipework configuration, it is impossible to measure before the prefilter but comparison to the compressor setpoint showed a maximum pressure drop of just 0.2 barg. This is acceptable.

## 2.5 Presentation and Analysis of Distribution System

The piping network consists of 3 main systems:

- A galvanised system originally used to supply noncritical users
- A35NB stainless steel system installed in 2002 to supply critical class users
- A125/100NB stainless steel system installed in 2007 to supply the site

All three systems are located in the technical area above production. The systems have

developed over the years as more users were transferred onto the higher quality system and production increased. Currently users are supplied from all three systems although they are gradually being transferred onto the large new bore system. All three systems form ring mains around the production areas. New stainless steel drop lines supply a lot of the using areas but there are also still many users fed from nylon lines coming down from the technical area.

## 2.6 Production Lines Air Isolation and Vacuum Usage

Leaks are a part of every air system but if not regularly repaired will continue to grow and become an unacceptably high [14]. The normally accepted target for leaks is between 5 and 10% of demand. To assess leakage levels and identify potential savings an ultrasonic leak detection survey was undertaken [15,16]. Leaks found were identified and rated on a scale of A to J as shown in Table 3.

All leaks identified rated B or more should be addressed urgently. Leaks rated A should be carefully watched as they will increase over time and should then be rectified.

## 2.7 Partial Heat Recovery

As seen in Fig. 5, the heater of the main dryer (2250 m<sup>3</sup>) is supplied with warm air from the compressor exhaust. This is a clever approach to recover heat, although it is not applicable to all dryers as it needs a second cold air supply for cooling.

Table 3. Production line air isolation and vacuum usage

Scale	Estimated loss (cfm = Cubic feet per minute)		Estimated loss (m <sup>3</sup> /h)		Cost of a leak (€)	
	min	Max	Min	max	Min	max
A	0.01	0.50	0.02	0.81	0.98	48.89
B	0.50	1.50	0.81	2.42	48.89	146.66
C	1.50	2.50	2.42	4.03	146.66	244.44
D	2.50	4.00	4.03	6.44	244.44	391.10
I	4.00	6.00	6.44	9.66	391.10	586.66
F	6.00	8.00	9.66	12.88	586.66	782.21
G	8.00	10.00	12.88	16.11	782.21	977.76
H	10.00	15.00	16.11	24.16	977.76	1466.64
I	15.00	25.00	24.16	40.27	1466.64	2444.40
J	25.00	100.00	40.27	161.06	2444.40	9777.60

The above costs are based on running 7200 hours per year at a cost of 0.07 €/kWh



Warm air from  
compressor exhaust  
into dryer for heating

**Fig. 5. Heat recovery between compressor and dryer**

### 3. RESULTS AND DISCUSSION

#### 3.1 Pressure Functioning

The compressors are controlled from their individual pressure switches. At the start of the research the settings were as follows:

- Compressor 1 = 7.9 barg
- Compressor 2 = 7.5-7.6 barg
- Compressor 3 = 6.4 -6.9 barg

The settings on the fixed speed have been manually made to ensure the VSD stays on load. The compressor 3 setting is for emergencies only and is not considered a reasonable running pressure during production.

At high loads, the compressor 2 cycles rapidly on and off load whilst the VSD stays at maximum speed. This is due to the above settings as the VSD will only start to turn down at pressure at and above 7.9 barg whilst the compressor 1 will cycle between 7.5 and 7.6 barg.

During the research the pressures were reset as follows (immediate action):

- Compressor 1 = 7.3 barg
- Compressor 2 = 7.0-7.5 barg
- Compressor 3 = 6.4 – 6.9 barg

As stated by Vittorini and Cipollone [17], a 1 barg reduction, from an 8 barg pressure ratio leads to a 10% saving and the higher the delivered pressure, the lower the benefit: at 15 barg

delivery pressure, the 1 barg reduction leads to a 4% saving.

The new settings mean that the pressure is now reduced by 0.6 barg, saving around 4% power [18], but when the demand increases above the capacity of the compressor 1 (VSD), compressor 2 will start and then go on base load as the VSD controls. Once the demand drops below the capacity of the compressor 2 and the VSD on minimum speed, the pressure will increase causing the VSD to off load and then eventually stop as the VSD takes over the load.

The average specific power consumption has been reduced from 12.66 to 12.25 kW/100Nm<sup>3</sup>/h. The figure of 7.3 barg was chosen as a safe level and it is likely that the pressure can be reduced further.

A new set up can be put in place as long as there is no risk to production (i.e., pressure to production machines is maintained at a suitable level).

In addition to power consumption decrease at a set flow, pressure reduction also increases the maximum output from the compressor 1 (VSD). At 7 barg the maximum speed is 4300 rpm, dropping to 4020 rpm at 8.6 barg. The change from 7.9 to 7.3 barg should have increased output by around 40 m<sup>3</sup>/h.

### 3.2 Compressed Air Drying

The dryer is operating in dewpoint control [19]. The site energy monitoring system clearly shows a varying period between changeovers indicating

that the dryer is working well. Based on electrical meter in place, the dryer is consuming around 4% of the energy used by the duty VSD compressor. This is very low and indicates the dryer is running very efficiently. The dewpoint is monitored both on the dryer and externally using a site calibrated dewpoint meter. The results from this local meter are shown in Fig. 6 (the spikes indicating when the towers changeover).

### 3.3 Compressed Air Loops

The new compresses air loop is comfortably large enough for the demand with a maximum velocity of below 5.5 m/s at the peak demand if the entire load were on this system. 6 m/s is the recommended maximum velocity for main distribution lines, even if it can be significantly higher before pressure problems are seen. Unfortunately, a lot of the demand is still on the small old system. So, in order to check how this line is coping, the pressure is monitored at two points at the end of the manufacturing and packing areas.

The monitoring in the packing line shows a maximum 0.2 barg pressure drop. This is just on the limit of good practice. As the readings were taken during a period of low production levels and hence low demand, they indicate that the work being done to transfer users from the small 2002 system to the new larger stainless-steel system is important. Also, by having three systems, it is difficult to properly isolate the packaging lines as there are several feeds into each line.


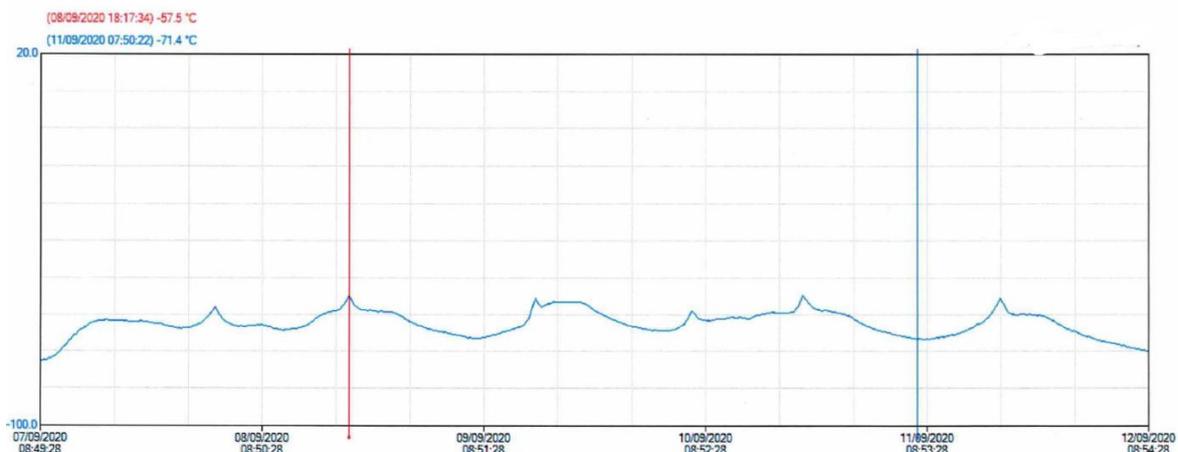


Fig. 6. Dewpoint of the installation – Y axis unit = °C and X axis unit = date & hour

**Table 4. The leaks distribution per area**

Area	Leaks number	Estimated loss		Estimated Cost pa
		cfm	m <sup>3</sup> /h	€
Technical area	3	8	13	782.21
Packaging	5	10.5	17	1026.65
Manufacturing	5	10	16	977.76
Dedusters	3	4.5	7	439.99
Total	16	33	53	2790.84

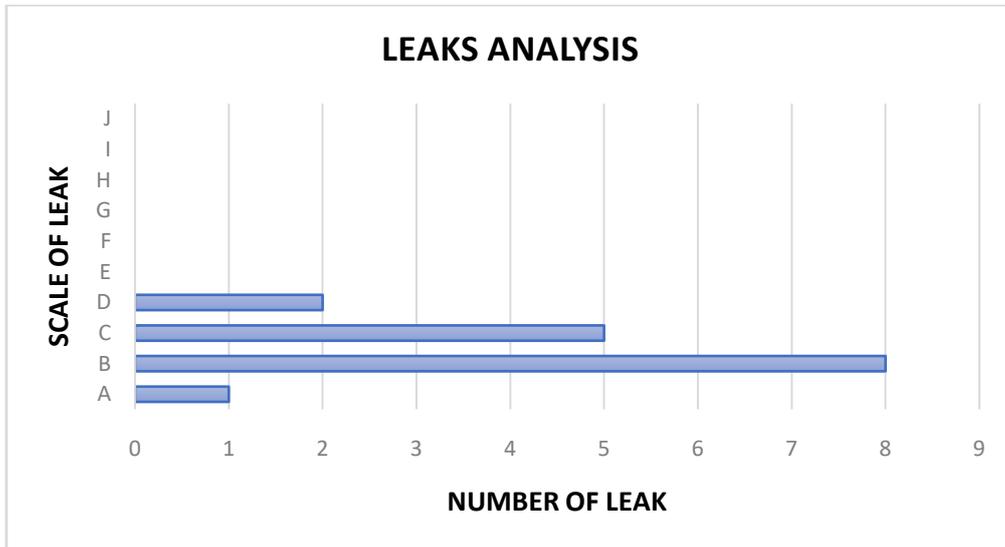

**Fig. 7. Leaks analysis (size and number)**

The monitoring in the manufacturing department shows a pressure drop that is less than 0.1 barg.

### 3.4 Compressed Air Leaks

16 leaks have been identified with a maximum potential loss of 33 cfm, 56 m<sup>3</sup>/h. This is quite a small number of leaks and shows the main areas are well maintained. The leaks distribution per area is indicated in Table 4.

The leaks were mainly small, as would be expected, with just 2 rated over 3 (one of which was easily repaired during the survey). The distribution is as shown in Fig. 7.

Reducing the demand by 56 m<sup>3</sup>/h would save 2800 €.

The purchase of an ultrasonic leak detector should be considered, and leak surveys and rectification should be conducted every three to six months. Alternatively, it may be acceptable to carry out checks by ear at weekends when the plant is quiet.

As demonstrated by M'Baye [20], develop and implement a shutdown procedure (for each production line) in order to reduce wastage. This should ensure all equipment, including compressed air, motors etc. are shut off when the machine is not in use.

Moreover, the lines should be fitted with automatic isolation valves so that air to the entire line is shutdown when the line is stopped.

### 3.5 Vacuum Systems

It was also noted that 10 of the 11 packaging lines had venturi vacuum systems. The efficiency of these can vary considerably and for a continually running system it can cost up to 10 times more to run a venturi system than a dedicated electric vacuum pump [21]. Compressed air venturi vacuum devices must be replaced by electrically driven vacuum pumps. The machine manufacturers should be consulted, along with vacuum pump suppliers.

Based on an estimated vacuum demand of around 15 m<sup>3</sup>/h per line, it has been calculated a

saving of over 4450 € per year by switching to electrically operated vacuum pumps (assuming running around 50% of the time).

When converting vacuum systems, it is necessary to ensure that the draw down times are still suitable for the application. The use of vacuum pumps will increase heat into the area and may have a detrimental effect on the HVAC (Heating Ventilation Air Conditioning) energy usage if located in the production area [22].

### 3.6 Smart Management Device

There is currently no intelligence in the operation of compressors related to energy management.

Compressors 2 and 3 run only when there is an additional flow demand (no routine start). There is also no centralization and digitization of compressed air system information related to maintenance plans.

The installation of a smart box like the one represented in Fig. 8 will centralize the operation, energy management and data monitoring of the compressed air system through [23]:

- Intelligent compressor start-up:
  - Algorithm for improving energy consumption (i.e., operating the "compressor mix" in the most ecological and economical way possible)

- Automatic start of the compressors which are in backup (increased reliability of compressed air production)

- Centralization of compressed air system information:

- connection with the BMS
- Management of remote alarms / on-condition indicators
- Single point of monitoring for maintenance
- Centralization of set points

This equipment will also simplify maintenance tasks: Digital recording of information, remote monitoring of information and no need for routine maintenance for the device (except annual calibration).


In case of failure of the smart box, the compressors will be autonomous, and the alarms will be managed by the BMS (production of compressed air always ensured).

### 3.7 Total Heat Recovery

Heat recovery on compressed air (either cooled by air or water) is possible and the principle is similar to heat recovery thanks to a heat pump [24] and internal combustion engine [25]. The potential to recover heat from air cooled machines is predominantly ducting the hot exhaust air for space heating.



Fig. 8. Sigma Air manager® by Kaiser

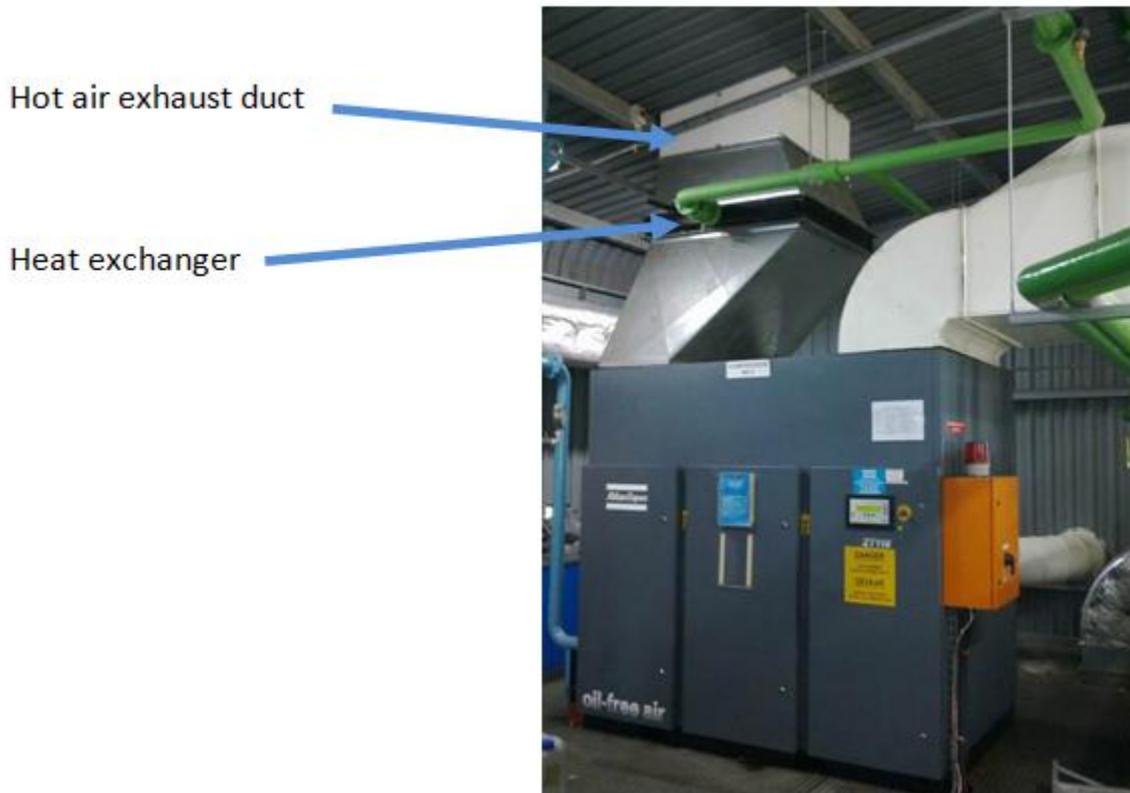

**Fig. 9. Example of heat recovery on a compressed air to produce hot water thanks to an exchanger**

The site of this case study has 2 warehouses that need heating. The practicality of ducting the hot air into the adjacent warehouses is not good. In fact, there are critical products in those warehouses (air must be treated to meet requirement) and there is no clear route for the ducting as there are toilets and offices immediately adjacent to the compressor house wall. Nevertheless, it is possible to recover some heat for hot water by installing a heat exchanger in the exit duct. Fig. 9 is an example of such installation (heat recovery on a fixed speed compressor that provides a continuous heat load and can provide water temperatures of over 35°C).

In this case study, the heat available is much more varied (as the load is variable). During daytime production temperatures measured in the exhaust air duct are low, at times less than 35 °C, increasing to nearer 50 °C at higher loads. There is also no obvious use for warm water, the boilers are close but with return temperatures of

close to 75°C they would not be able to utilise such low-grade heat.

This heat could be used for preheating the water in the washing room or directly for preheating the water destined to the domestic hot water (simpler solution and maximum recovery). Needs identified: Washing room = 347 MWh/year; Domestic Hot Water = 400 MWh/year.

As stated before, a proportion of the hot exhaust air is recovered for use in the dryer regeneration cycle. Although this does not use much of the compressor heat available, it is a good practice and will help keep the dryer running costs as low as possible [26].

### 3.8 Actions Plan Summary

The recommendations are listed in Table 5. There are prioritised, reflecting a balance between the time to implement, estimated cost to implement and savings expected.

**Table 5. Recommendations summary**

Priority	Recommended actions	Summary				
		Estimated annual savings			Estimated cost	Payback period (years)
		€	kWh	CO <sub>2</sub> (tonnes)	€	
1	Reduce leaks	2623	37474	3.11	2400	0.9
2	Reduce system demand pressure	1849	26411	2.19	0	0.0
3	Isolate packaging lines when stopped	11131	159010	13.20	55200	5.0
4	Increase efficiency of vacuum generation on packaging lines	4469	63840	5.30	18000	4.0
5	Implement smart management device	14336	321126	26.65	24000	1.7
6	Heat recovery	10000	224000	18.59	32000	3.2
-	<b>Total</b>	<b>44408</b>	<b>631296</b>	<b>69.04</b>	<b>131600</b>	<b>2.47</b>

**4. CONCLUSION**

In summary, the decarbonisation process in industries requires several stages and the consumption of new materials for complete optimization with the use of compressed air on industrial sites. New technology and innovation have also been taken into consideration. The total savings identified are up to 69 tons of CO<sub>2</sub> gas. At the same time, substantial financial savings have been identified (up to 44 k€). Once consumption has been optimized, the next step is to supply the equipment with renewable energy such as solar panels and wind turbines. However, we must not completely disregard the risk factor for accidents involved, as well as the safety of the environment, bodies of water, and human workers involved near the systems under high pressure (minimum 4 barg).

**COMPETING INTERESTS**

Author has declared that no competing interests exist.

**REFERENCES**

- Herrera HH, Villalba DP, Angarita EN, Ortega JS, Echavarría CC. Energy savings in compressed air systems a case of study. In IOP Conference Series: Materials Science and Engineering. IOP Publishing. 2021, June;1154(1):012009. DOI:https://doi.org/10.1088/1757-899X/1154/1/012009
- Byun Manhee, Lim Dongjun, Lee Boreum, Kim Ayeon, Lee In-Beum, Brigljević Boris,

Lim Hankwon, Economically feasible decarbonization of the Haber-Bosch process through supercritical CO<sub>2</sub> Allam cycle integration. Applied Energy. 2022; 307:118183. ISSN 0306-2619. DOI:https://doi.org/10.1016/j.apenergy.2021.118183

- Herrera HH, Silva-Ortega JI, Diaz VLM, Pons AG, Sanchez ZG. Potential Energy savings in compressed air systems in industrialized cities. A case study in Barranquilla and Cartagena. In IOP Conference Series: Materials Science and Engineering. IOP Publishing. 2020, May;844(1):012019. DOI:https://doi.org/10.1088/1757-899X/844/1/012019
- Lu Zisheng. Experimental analysis of one micro-compressed air energy storage-power generation system with different working fluids. Journal of Energy Storage. 2023;60:106647. ISSN 2352-152X. DOI:https://doi.org/10.1016/j.est.2023.106647
- Widayati Endang, Nuzahar Hasril. IOP Conf. Ser.: Mater. Sci. Eng. 2016;105:012018. DOI :https://doi.org/10.1088/1757-899X/105/1/012018
- Cabello Eras Juan José, Sagastume Gutiérrez Alexis, Sousa Santos Vladimir, Cabello Ulloa Mario Javier. Energy management of compressed air systems. Assessing the production and use of compressed air in industry. Energy. 2020;213:118662.

- ISSN 0360-5442.  
DOI:<https://doi.org/10.1016/j.energy.2020.118662>
7. Giampieri A, Ling-Chin J, Ma Z, Smallbone A, Roskilly AP. A review of the current automotive manufacturing practice from an energy perspective. *Applied Energy*. 2020;261:114074. ISSN 0306-2619. DOI:<https://doi.org/10.1016/j.apenergy.2019.114074>
  8. Mousavi Smaeil, Kara Sami, Kornfeld Bernard. Energy efficiency of compressed air systems. *Procedia CIRP*. 2014;15:313-318. ISSN 2212-8271. DOI:<https://doi.org/10.1016/j.procir.2014.06.026>
  9. Çağman Selman, Soylu Eren, Ünver Ümit. A research on the easy-to-use energy efficiency performance indicators for energy audit and energy monitoring of industrial compressed air systems. *Journal of Cleaner Production*. 2022;365:132698. ISSN 0959-6526, DOI:<https://doi.org/10.1016/j.jclepro.2022.132698>.
  10. Shannon, Tommy. A case study of energy efficient measures undertaken in an industrial facility. *SDAR\* Journal of Sustainable Design & Applied Research*. 2018;6(1):Article 3. DOI: <https://doi.org/10.21427/D74C07>
  11. Trianni Andrea, Cagno Enrico, Accordini Davide. Energy efficiency measures in electric motors systems: A novel classification highlighting specific implications in their adoption, *Applied Energy*. 2019;252:113481. ISSN 0306-2619. DOI:<https://doi.org/10.1016/j.apenergy.2019.113481>
  12. Saidur R, Mekhilef S, Ali MB, Safari A, Mohammed HA. Applications of variable speed drive (VSD) in electrical motors energy savings, *Renewable and Sustainable Energy Reviews*. 2012a;16(1): 543-550. ISSN 1364-0321, DOI:<https://doi.org/10.1016/j.rser.2011.08.020>
  13. Saidur R., Review on electrical motors energy use and energy savings, *Renewable and Sustainable Energy Reviews*, Volume 14, Issue 3, 2010, Pages 877-898, ISSN 1364-0321, DOI:<https://doi.org/10.1016/j.rser.2009.10.018>
  14. Abela Kyle, Refalo Paul, Francalanza Emmanuel. Analysis of pneumatic parameters to identify leakages and faults on the demand side of a compressed air system. *Cleaner Engineering and Technology*. 2022;6:100355. ISSN 2666-7908, DOI:<https://doi.org/10.1016/j.clet.2021.100355>
  15. Soylu E, Bilgin H, Cagman S. and Unver U. An ultrasonic application to evaluate energy costs of air leakages at the compressed air systems. 2021 6th International Conference on Smart and Sustainable Technologies (SpliTech), Bol and Split, Croatia. 2021;1-3. DOI:<https://doi.org/10.23919/SpliTech52315.2021.9566418>
  16. Mbaye A., Review on energy audit: benefits, barriers, and opportunities. *American Journal of Energy and Natural Resources*. 2022a;1(1):45–58. DOI:<https://doi.org/10.54536/ajenr.v1i1.1054>
  17. Vittorini D, Cipollone R. Carbon and energy saving financial opportunities in the industrial compressed air sector. In *IOP Conference Series: Materials Science and Engineering*. 2017;232(1):012085. IOP Publishing. DOI:<https://doi.org/10.1088/1757-899X/232/1/012085>
  18. Aldona Kluczek, Paweł Olszewski, Energy audits in industrial processes, *Journal of Cleaner Production*, Volume 142, Part 4, 2017, Pages 3437-3453, ISSN 0959-6526, DOI:<https://doi.org/10.1016/j.jclepro.2016.10.123>
  19. Baghban Alireza, Bahadori Mohammad, Rozyn Jake, Lee Moonyong, Abbas Ali, Bahadori Alireza, Rahimali Arash. Estimation of air dew point temperature using computational intelligence schemes. *Applied Thermal Engineering*. 2016; 93:1043-1052. ISSN 1359-4311. DOI:<https://doi.org/10.1016/j.applthermaleng.2015.10.056>
  20. M'baye A. Carbon emission efficiency best practices: a case study in an industrial site. *Journal of Energy Research and Reviews*. 2022b;10(3):10–23. DOI:<https://doi.org/10.9734/jenrr/2022/v10i330256>
  21. Singhal DK. Energy audit of vacuum system. *IPPTA*. 2007;19(2):129. DOI:<https://doi.org/10.21427/D74C07>
  22. M'Baye Abaubakry, Reduction of Carbon Emissions of HVAC Systems: A Case Study of a Pharmaceutical Site in France,

- International Journal of Energy Engineering. 2022;12(1):1-14.  
DOI: 10.5923/j.ijee.20221201.01
23. Nehler Therese. Linking energy efficiency measures in industrial compressed air systems with non-energy benefits – A review. Renewable and Sustainable Energy Reviews. 2018;89:72-87.  
ISSN 1364-0321.  
DOI:<https://doi.org/10.1016/j.rser.2018.02.018>
24. M'Baye A., A case study of heat recovery: a heat pump in an industrial site. Renewable Energy and Sustainable Development. 2022c;8.  
DOI:<http://dx.doi.org/10.21622/resd.2022.08.1.020>
25. Saidur R, Rezaei M, Muzammil WK, Hassan MH, Paria S, Hasanuzzaman M, Technologies to recover exhaust heat from internal combustion engines. Renewable and Sustainable Energy Reviews. 2012b; 16(8): 5649-5659.  
ISSN 1364-0321.  
DOI:<https://doi.org/10.1016/j.rser.2012.05.018>
26. Saidur R, Rahim NA, Hasanuzzaman M. A review on compressed-air energy use and energy savings. Renewable and Sustainable Energy Reviews. 2010;14(4):1135-1153.  
ISSN 1364-0321.  
DOI:<https://doi.org/10.1016/j.rser.2009.11.013>

© 2023 Thomas; This is an Open Access article distributed under the terms of the Creative Commons Attribution License (<http://creativecommons.org/licenses/by/4.0>), which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

*Peer-review history:*

*The peer review history for this paper can be accessed here:*  
<https://www.sdiarticle5.com/review-history/98265>